

GRINNELL G-FIRE Figure 40-5 Strap (Pipe Outlet) Americas Only

IMPORTANT

Refer to Technical Data Sheet TFP2300 for warnings pertaining to regulatory and health information.

Scan the QR code or enter the URL in a web browser to access the most up-to-date electronic version of this document. Data rates may apply.



docs.jci.com/tycofire/TFP1720

General Description

The GRINNELL G-FIRE Figure 40-5 Strap is an economical alternative to welded pipe outlets on steel pipe. The Figure 40-5 Strap can be used with full lengths of pipe and eliminates welding, decreasing waste and installation time. The Figure 40-5 Strap can be used in wet, dry pipe, and deluge systems and is rated to a maximum pressure of 175 psi (12 bar).

NOTICE

The Figure 40-5 Strap described herein must be installed and maintained in compliance with this document, and with the applicable standards of the NATIONAL FIRE PROTECTION ASSOCIATION (NFPA), in addition to the standards of any authorities having jurisdiction. Failure to do so may impair the performance of this device.

Owners are responsible for maintaining their fire protection system and devices in proper operating condition. Contact the installing contractor or product manufacturer with any questions.

Technical Data

Approvals

UL and ULC Listed
FM Approved

Listed/Approved Pressure Ratings

See Table A

Sizes

Pipe Run:
1-1/4 in. to 2-1/2 in. (DN32 to DN65)

Outlet Thread:
1/2 in. NPT to 1 in. NPT

Housing

Ductile iron conforming to ASTM A536,
Grade 65-45-12

Protective Coatings

Clear rust inhibitive coating

Friction Loss

When calculating system friction loss, fittings featuring 1 in. outlets shall be represented by 5 ft (1.52 m) equivalent length of 1 in. (DN25) sch. 40 pipe.

Notes: Hazen Williams coefficient = 120

The 1 in. outlets must be used in fire protection systems leading to a connection to system piping. These fittings should be used for hydraulically calculated systems only.

Bolts/Nuts

- The U-bolt is made from carbon steel conforming to ASTM A307 Grade A and zinc-electroplated conforming to ASTM B633.
- The flange nuts are made from carbon steel conforming to ASTM A563 Grade A, and zinc electroplated per ASTM B633.


Note: U-bolts and nuts are available in stainless steel upon request.

Bolt Torque Specifications

See Table B

Gasket

Refer to data sheet TFP1895 for additional gasket information.

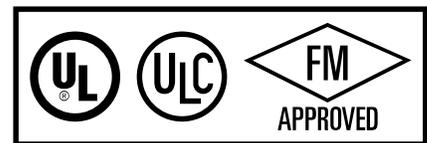

Care and Maintenance

The GRINNELL G-FIRE Figure 40-5 Strap must be maintained in accordance with this section.

Before closing a fire protection system main control valve for maintenance work on the fire protection system that it controls, obtain permission to shut down the affected fire protection system from the proper authorities and notify all personnel who may be affected by this decision.

After placing a fire protection system in service, notify the proper authorities and advise those responsible for monitoring proprietary and/or central station alarms.


The owner is responsible for the inspection, testing, and maintenance of their fire protection system and devices in compliance with this document, as well as with the applicable standards of the NFPA such as NFPA 25, in addition to the standards of any authority having jurisdiction. Contact the installing contractor or product manufacturer with any questions. Any impairments must be immediately corrected.

Automatic sprinkler systems are recommended to be inspected, tested, and maintained by a qualified Inspection Service in accordance with local requirements and/or national codes.

Nominal Run Size ANSI Inches (DN)	O.D. Inches (mm)	Outlet Size NPT	Nominal Dimensions Inches (mm)					Approx. Weight lbs (kg)
			A	B	C	D	E ¹	
1-1/4 (32)	1.660 (42,4)	1/2	2.00 (50,8)	1.50 (38,1)	3.50 (88,9)	1.20 (30,5)	1.375 (34,9)	0.84 (0,4)
		3/4	2.00 (50,8)	1.50 (38,1)	3.50 (88,9)	1.20 (30,5)		0.88 (0,4)
1-1/2 (40)	1.900 (48,3)	1/2	2.12 (53,8)	1.62 (41,1)	3.50 (88,9)	1.32 (33,5)		0.84 (0,4)
		3/4	2.12 (53,8)	1.62 (41,1)	3.50 (88,9)	1.32 (33,5)		0.88 (0,4)
2 (50)	2.375 (60,3)	1/2	2.36 (59,9)	1.86 (47,2)	3.74 (95,0)	1.55 (39,4)		0.88 (0,4)
		3/4	2.36 (59,9)	1.86 (47,2)	3.74 (95,0)	1.55 (39,4)		0.95 (0,4)
		1	2.67 (67,8)	2.04 (51,8)	3.74 (95,0)	1.55 (39,4)	1.500 (38,0)	1.16 (0,5)
2-1/2 (65)	2.875 (73,0)	1/2	2.61 (66,3)	2.11 (53,6)	4.25 (108,0)	1.80 (45,7)	1.375 (34,9)	0.90 (0,4)
		3/4	2.61 (66,3)	2.11 (53,6)	4.25 (108,0)	1.80 (45,7)		0.99 (0,5)
		1	2.92 (74,2)	2.29 (58,2)	4.25 (108,0)	1.80 (45,7)	1.500 (38,0)	1.21 (0,5)

Notes

1. Dimension E is the pipe hole cut diameter. Use values provided for fittings having part numbers ending with the K suffix. For all other part numbers, the pipe hole cut diameter is 1.19 in. (30,0 mm). The tolerance is +0.02 in. (0,5 mm), - 0 in. (0 mm).

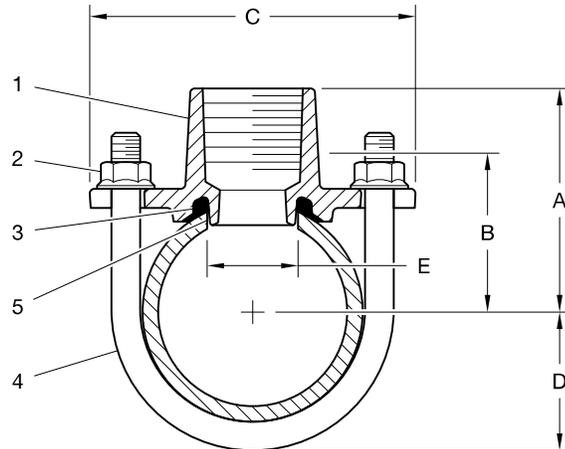

Item	Description
1	Housing
2	Flanged Nut
3	Gasket
4	U-Bolt
5	Cut Pipe Hole

FIGURE 1
FIGURE 40-5 STRAP (PIPE OUTLET)
FEATURES AND NOMINAL DIMENSIONS

Pipe Schedule	Bolt Torque Range lb-ft (N·m)
Schedule 5, 10	15 - 20 (20 - 27)
Schedule 30	25 - 30 (34 - 41)
Schedule 40	25 - 30 (34 - 41)

TABLE B
FIGURE 40-5 STRAP OUTLET
BOLT TORQUE SPECIFICATIONS

Limited Warranty

For warranty terms and conditions, visit www.tyco-fire.com.

Ordering Procedure

GRINNELL products are available globally through a network of distribution centers. For the nearest distributor, visit www.tyco-fire.com. When placing an order, indicate the full product name.

Specify: G-FIRE Figure 40-5 Strap, (size), (quantity), P/N (specify):

- 1-1/4" x 1/2 NPT STP1305ESK
- 1-1/4" x 3/4 NPT STP13075ESK
- 1-1/2" x 1/2 NPT STP1505ESK
- 1-1/2" x 3/4 NPT STP15075ESK
- 2" x 1/2 NPT STP2005ESK
- 2" x 3/4 NPT STP20075ESK
- 2" x 1 NPT STP2010ESK
- 2-1/2" x 1/2 NPT STP2505ESK
- 2-1/2" x 3/4 NPT STP25075ESK
- 2-1/2" x 1 NPT STP2510ESK

Nominal Pipe Sizes ANSI Inches	Pipe Schedule ^a	Pressure Rating psi (bar)		
		UL	ULC	FM
1-1/4 x 1/2; 3/4 1-1/2 x 1/2; 3/4 2 x 1/2, 3/4; 1 2-1/2 x 1/2; 3/4; 1	10	175 (12)	175 (12)	175 (12)
	40	175 (12)	175 (12)	175 (12)

NOTES

a. See Agency website for Listing/Approvals of other pipe specifications:
UL Website - see Online Certificate Directory, www.ul.com
FM Global Website - www.approvalguide.com

TABLE A
LISTED/APPROVED PRESSURE RATINGS